



## QUADRUPLEX STACK MOUNTED DRY ROTARY VANE MEDICAL VACUUM SYSTEMS 7.5 THROUGH 10 HP

The **Alert-2** continuous duty stack mounted Medical Vacuum system is a completely packaged NFPA 99 and NEC compliant assembly featuring dry rotary vane vacuum pumps, a U.L. listed electrical control cabinet, an ASME receiver and the necessary accessories required to meet and exceed the current code requirements. All components are pre-piped and pre-wired to single-point service connections. The only field connections are air intake, air discharge and power connection at the control panel. All interconnecting piping as well as wiring is completed and operationally tested prior to shipment. Liquid tight conduit, fittings and junction boxes are provided for all control and power wiring.


The medical vacuum pumps are continuous duty oil-less rotary vane air-cooled type. Each vacuum pump is driven by a 3 phase, 60 cycle, TEFC NEMA C-face, foot mounted motor.

The system includes a vacuum storage tank of ASME construction rated for full vacuum service. The tank is equipped with a vacuum gauge, valved by-pass and manual tank drain.

Also included as standard equipment for each vacuum pump are: inlet check valve, inlet isolation valve, inlet filter screen, vacuum control switch, bronze or stainless steel flexible connectors on inlet and discharge lines as well as copper tubing with shut-off cock for gauge and vacuum switches.

The system includes a UL labeled control panel in a NEMA 12 enclosure. The panel includes the following standard accessories for **each** pump: externally operable circuit breaker with a door interlock, control circuit transformer with fused primary and secondary coils, H-O-A switch, run light, hour meter, magnetic starter with 3 leg overload protection and reset switch and minimum run timer to prevent short cycle operation. The panel is equipped with a multiple position selector switch for selection of normal operation (automatic alternation) or manual selection of lead and lag pumps if one of the pumps is taken out of service due to scheduled maintenance.

Local "Backup in use" audible and visual alarms are provided per NFPA 99. The alarm includes an indicating light as well as the horn. The audible alarm can be acknowledged with the "Silence" button. The visual alarm will remain energized until the problem has been corrected. Each alarm function includes a set of dry contacts for connection to the master alarm. All control and alarm functions will remain energized while any vacuum pump in the system remains electrically on-line.

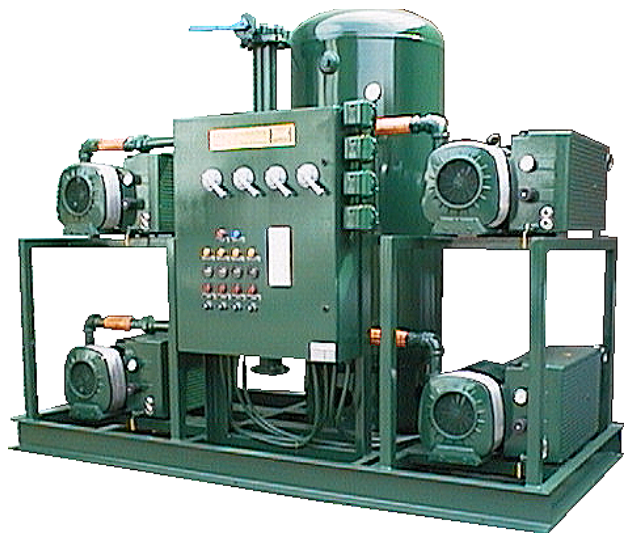

Field adjustable control switches are pre-set to operate the lead vacuum pump between 20" Hg and 22" Hg, the lag 1 pump between 19" Hg and 22" Hg and the lag 2 pump between 18" Hg and 22" Hg. The stand-by vacuum pump will automatically start at 17" Hg if one of the other vacuum pumps fails to operate.

The Medical Vacuum system is guaranteed by the manufacturer for a period of 12 months from the date of start-up or 18 months from the date of shipment (whichever comes first) against defects in design, materials, or construction.

### Optional System Accessories

(only checked options will be supplied)

- Rust protection receiver lining
- Galvanized receiver
- Receiver gauge glass
- Interface to AIMS (AMICO Information Management System)